



Headline Statistics

WCWSS DAM STORAGE
(%)

92.4

WEEKLY DAM LEVEL CHANGE
(%)

1.40

AVERAGE TOTAL
DAILY WATER USE
(MLD)

796

Water Resource Status

WATER RESOURCE STATUS	MEANING OF CURRENT STATUS
Wise Water Use	Although the water resource status is "wise water use", it is important to continue using water wisely. Note: The Water Resource status is updated every three (3) months. It will next be updated in November.

Water Production from Different Sources

MAJOR DAMS
(MLD)

768


MINOR DAMS
(MLD)

20

GROUND WATER
AND SPRINGS
(MLD)

8

Overall Water Usage Trend (2010 - Present)

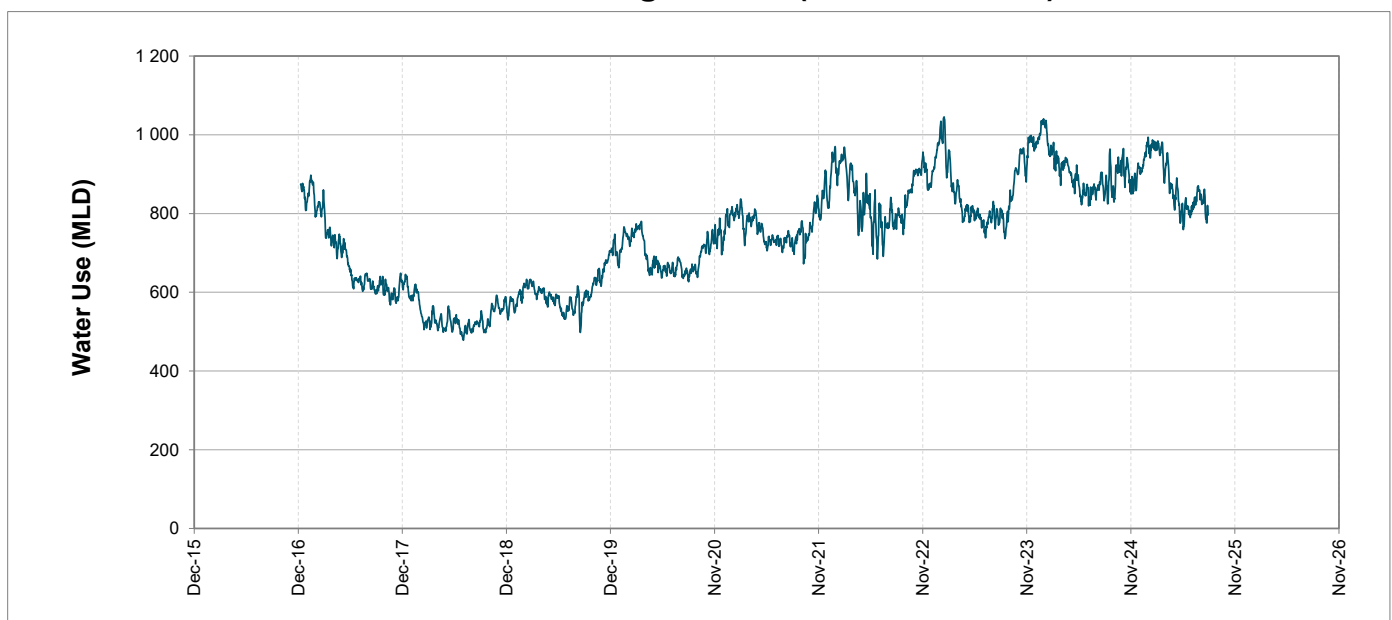

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website

Water Stored in Major Dams (WCWSS)

Overall Percentage Full


92.4%

Weekly Change


1.4%

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	28 August 2025	Previous week	2024	2023	2022	2021
BERG RIVER	130 010	100.4	100.7	103.1	101.1	100.5	101.9
STEENBRAS LOWER	33 517	100.5	95.6	103.7	102.2	92.8	96.7
STEENBRAS UPPER	31 767	98.0	100.4	100.9	100.8	93.7	91.7
THEEWATERSKLOOF	480 188	87.1	86.0	106.6	105.5	82.6	103.9
VOËLVLEI	164 095	98.6	95.1	103.6	100.7	69.7	92.7
WEMMERSHOEK	58 644	93.4	91.9	100.2	100.0	81.0	100.0
TOTAL STORED	898 221	830 042	817 827	941 348	928 128	749 727	903 479
% STORAGE		92.4%	91.0%	104.8%	103.3%	83.5%	100.6%




WCWSS Storage Record (2008 - Present)

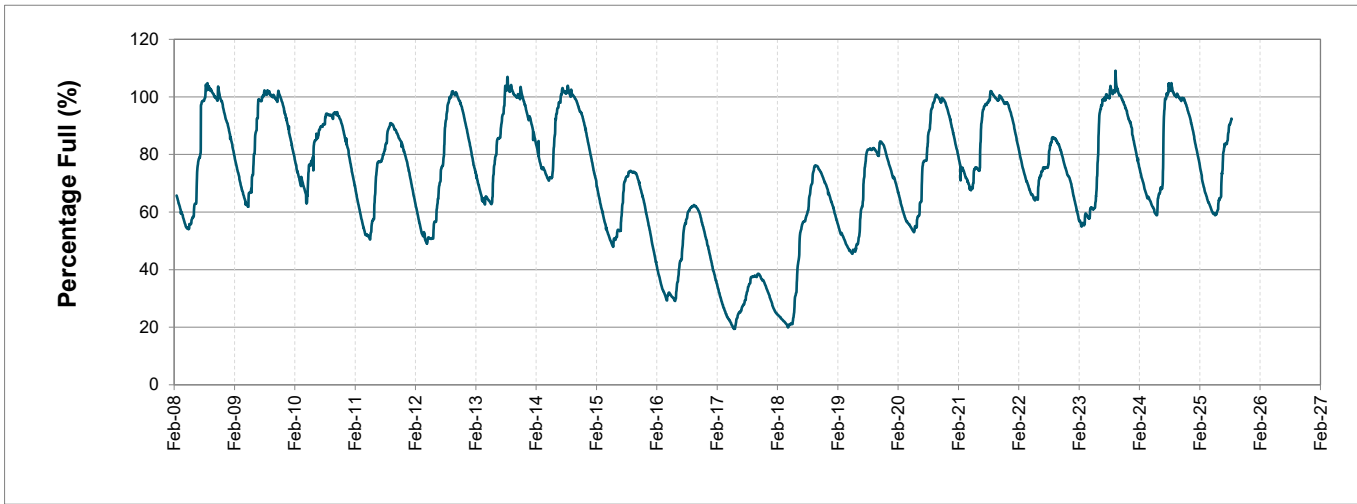

WCWSS Comparative Storage Graph

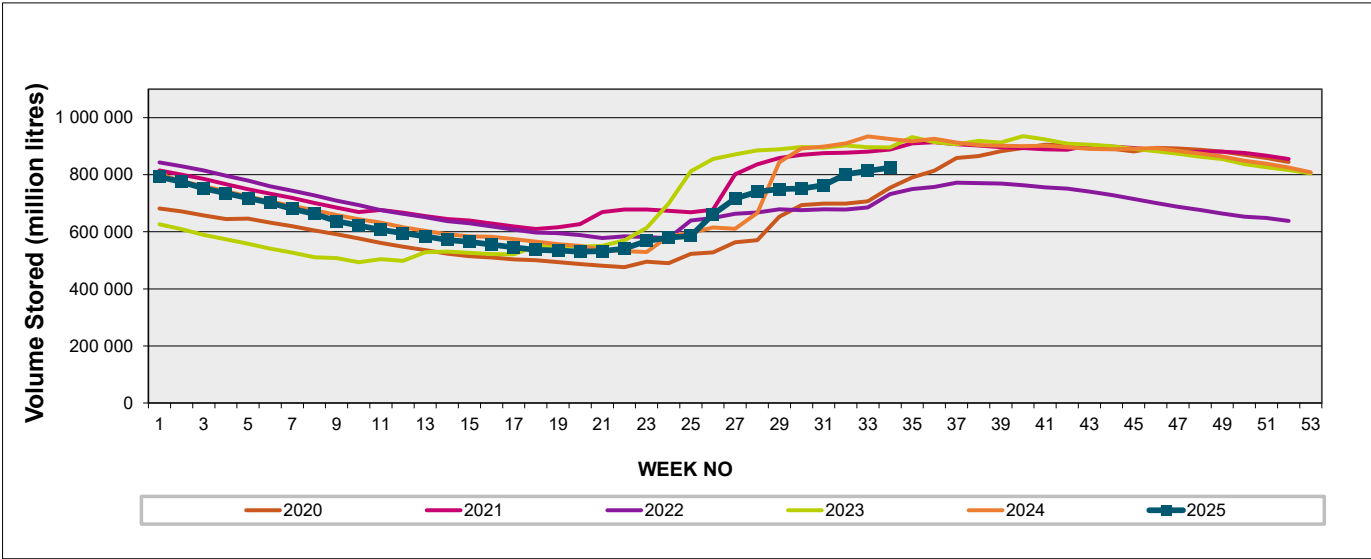

Projected WCWSS Dam Storage Levels

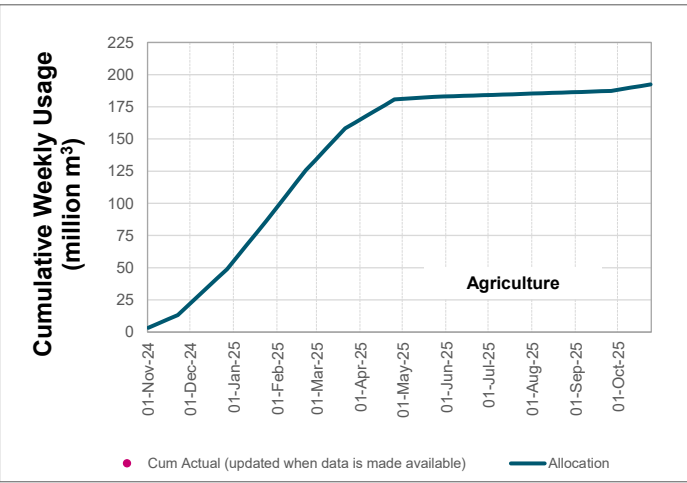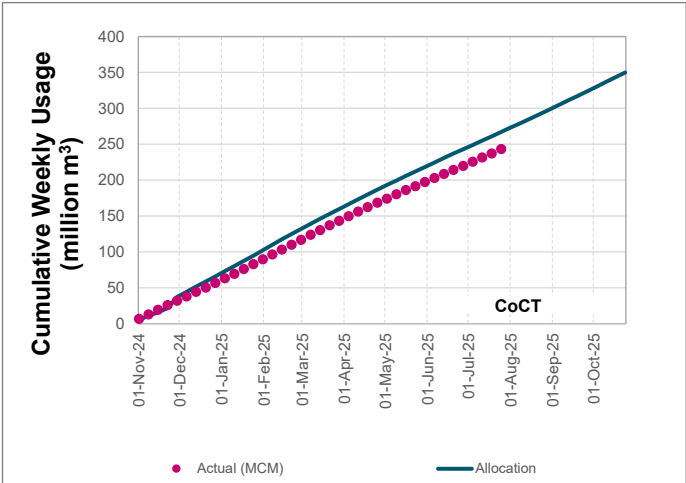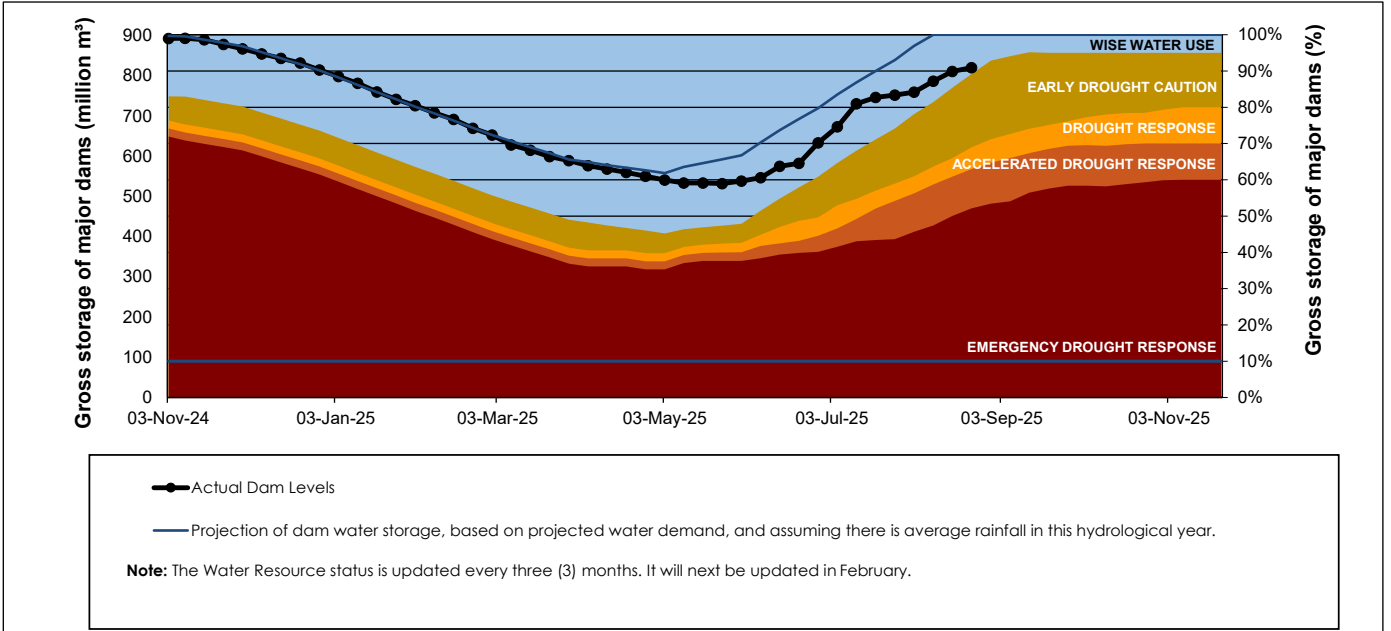

Water Stored in Minor Dams

Overall Percentage Full	87.4	Weekly Change	1.21
-------------------------	------	---------------	------

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	28 August 2025	Previous week	2024	2023	2022	2021
ALEXANDRA (Table Mountain)	126	81.8	83.1	ND	100.0	96.6	54.3
DE VILLIERS (Table Mountain)	243	100.0	100.9	ND	100.2	99.8	95.1
HELY-HUTCHINSON (Table Mount)	925	99.3	100.3	ND	99.8	101.5	101.2
KLEINPLAATS (Simon's Town)	1 368	68.5	68.0	99.1	100.2	71.3	100.0
LAND-EN-ZEEZICHT (Helderberg)	451	100.0	100.0	100.0	99.4	84.9	100.0
LEWIS GAY (Simon's Town)	182	100.9	100.9	100.9	100.9	43.6	100.9
VICTORIA (Table Mountain)	128	67.3	62.4	ND	101.5	101.2	104.2
WOODHEAD (Table Mountain)	954	97.8	92.2	ND	98.9	95.7	100.0
Total Stored	4 377	3825.0	3772.2	ND	4318.5	3756.5	4271.2
Percentages stored		87.4	86.2	ND	98.7	85.8	97.6


Rainfall Recorded

RAINFALL (mm)	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	Aug	
								Total*	LT Average
Blackheath Upper	2.0	5.0	0.0	0.0	0.0	0.0	0.0	46.2	77.7
Brooklands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	76.0	135.1
Newlands	8.5	8.0	0.0	0.0	0.0	0.0	0.0	193.2	237.0
Steenbras	16.0	9.8	2.0	0.0	0.0	0.0	0.0	108.3	127.1
Table Mountain (Woodhead)	3.0	10.5	4.0	0.0	0.0	0.0	0.0	114.1	215.8
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	0.0	28.2	76.0
Tygerberg	2.0	10.0	6.0	0.0	0.0	0.0	0.0	81.6	86.5
Voëlvlei	9.0	1.0	0.8	0.2	0.0	0.0	0.0	55.9	90.2
Wemmershoek	10.9	3.2	1.0	0.0	0.0	0.0	0.0	116.4	146.0
Wynberg	4.0	0.0	0.0	0.0	0.0	0.0	0.0	156.1	191.1

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

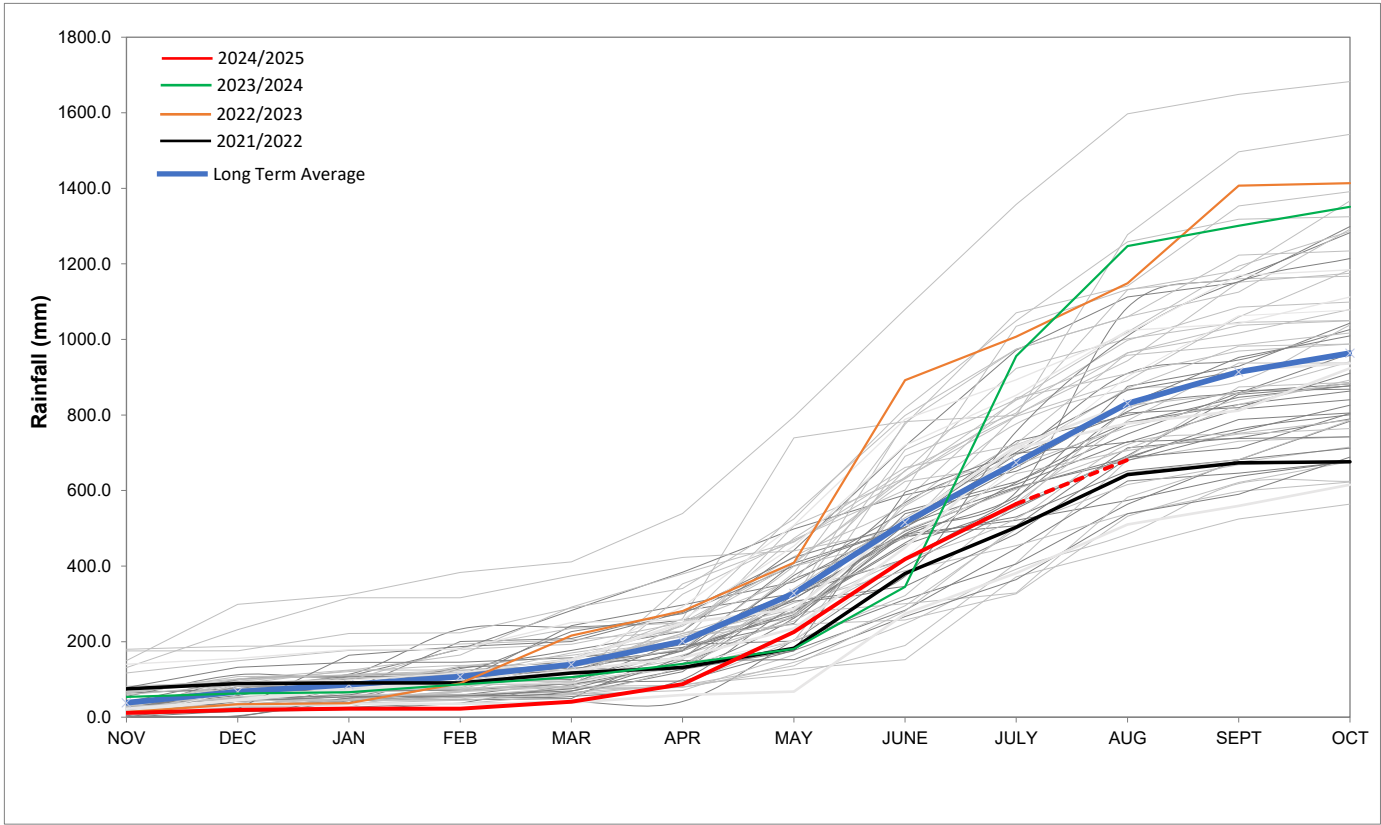

Drinking Water Quality

SAMPLE PASS RATE		
Month	Water Quality Compliance (%)	Target (%)
Nov-21	99.11	98
Dec-21	99.09	98
Jan-22	99.04	98
Feb-22	99.04	98
Mar-22	98.99	98
Apr-22	98.96	98
May-22	98.90	98
Jun-22	98.96	98
Jul-22	99.46	99
Aug-22	99.47	99
Sept-22	99.46	99.00
Oct-22	99.47	99.00
Nov-22	99.45	99.00
Dec-22	99.36	99.00
Jan-23	99.36	99.00
Feb-23	99.35	99.00
Mar-23	99.29	99.00
Apr-23	99.24	99.00
May-23	99.24	99.00
Jun-23	99.18	99.00
Jul-23	99.19	99.00
Aug-23	99.14	99.00
Sept-23	99.10	99.00
Oct-23	99.10	99.00
Nov-23	99.04	99.00
Dec-23	99.15	99.00
Jan-24	99.16	99.00
Feb-24	99.12	99.00
Mar-24	99.16	99.00
Apr-24	99.20	99.00
May-24	99.21	99.00
Jun-24	99.26	99.00
Jul-24	99.27	99.00
Aug-24	99.31	99.00
Sept-24	99.33	99.00
Oct-24	99.37	99.00
Nov-24	99.42	99.00
Dec-24	99.42	99.00
Jan-25	99.48	99.00
Feb-25	99.57	99.00
Mar-25	99.61	99.00
Apr-25	99.65	99.00
May-25	99.66	99.00
Jun-25	99.62	99.00
Jul-25	99.69	99.00

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 99%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.