
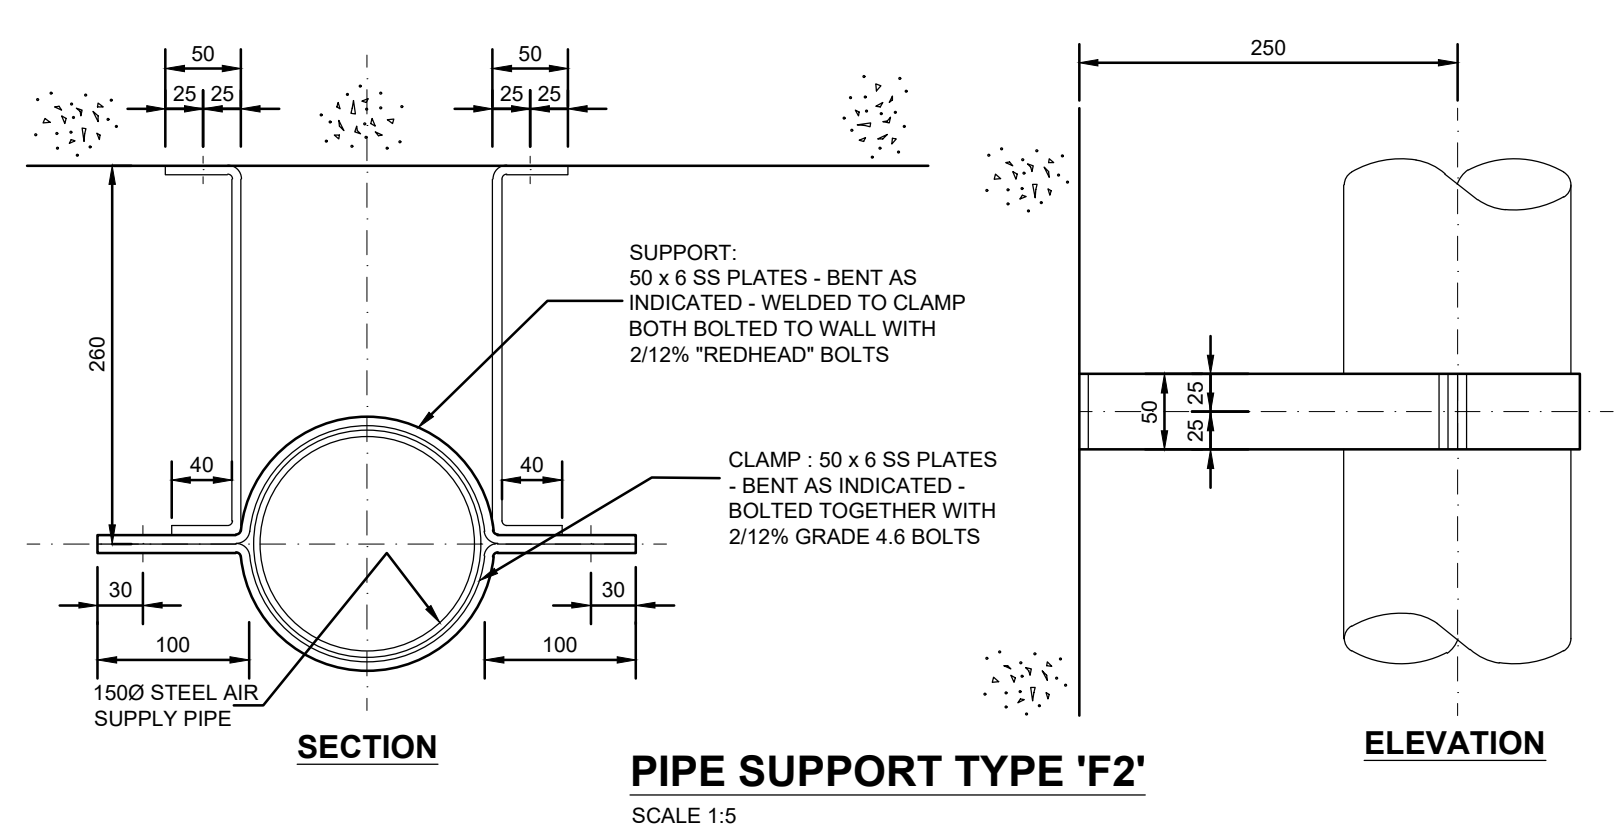
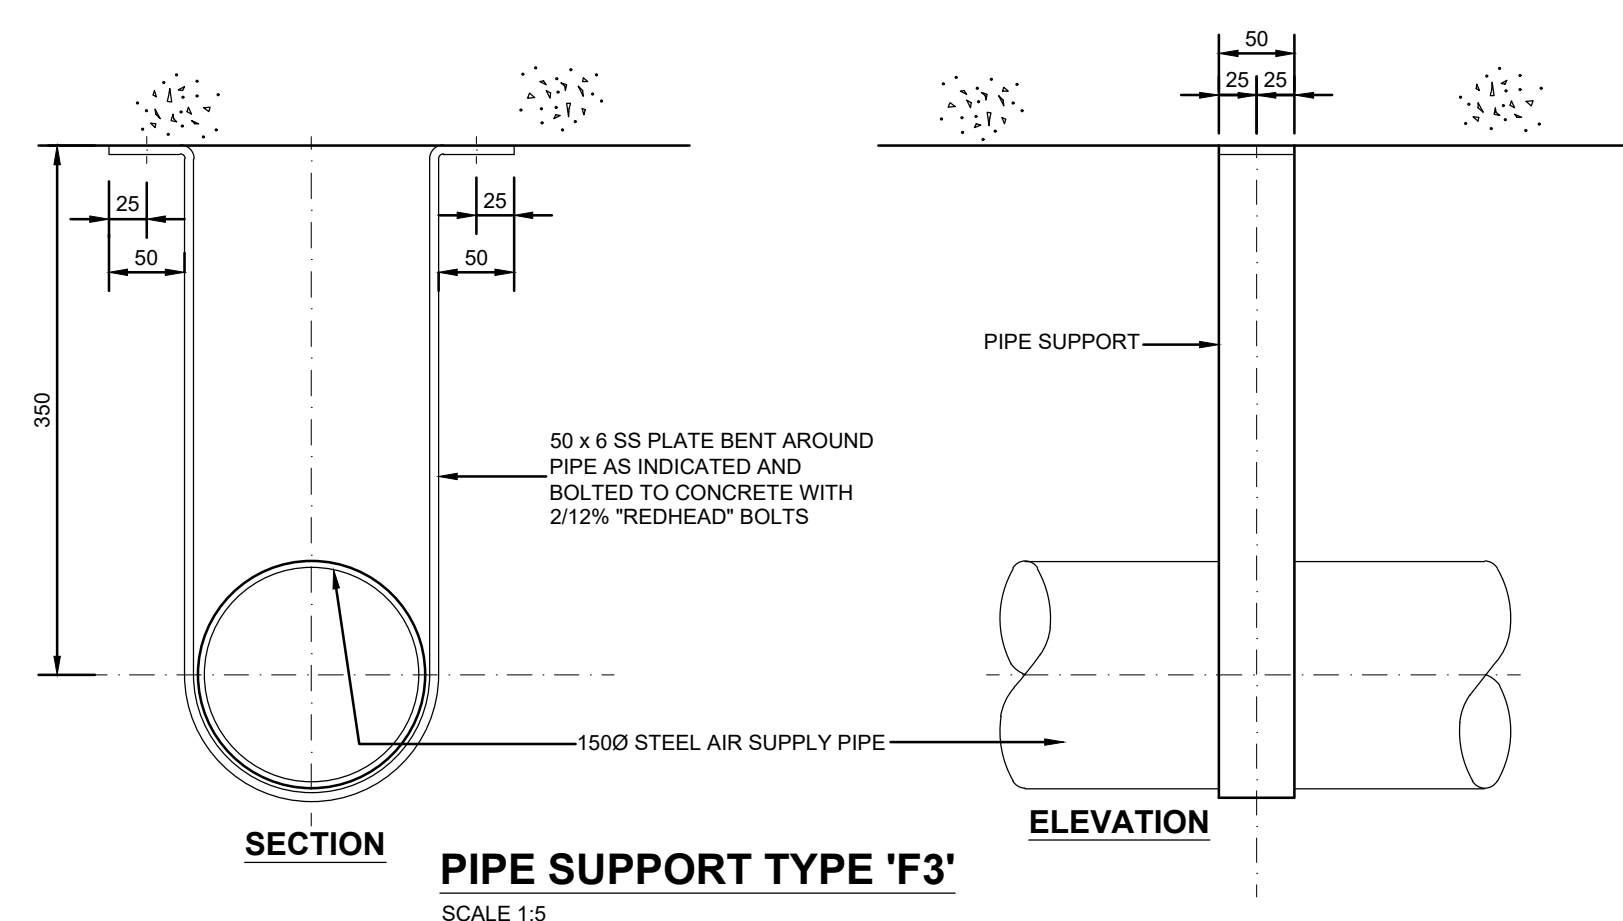
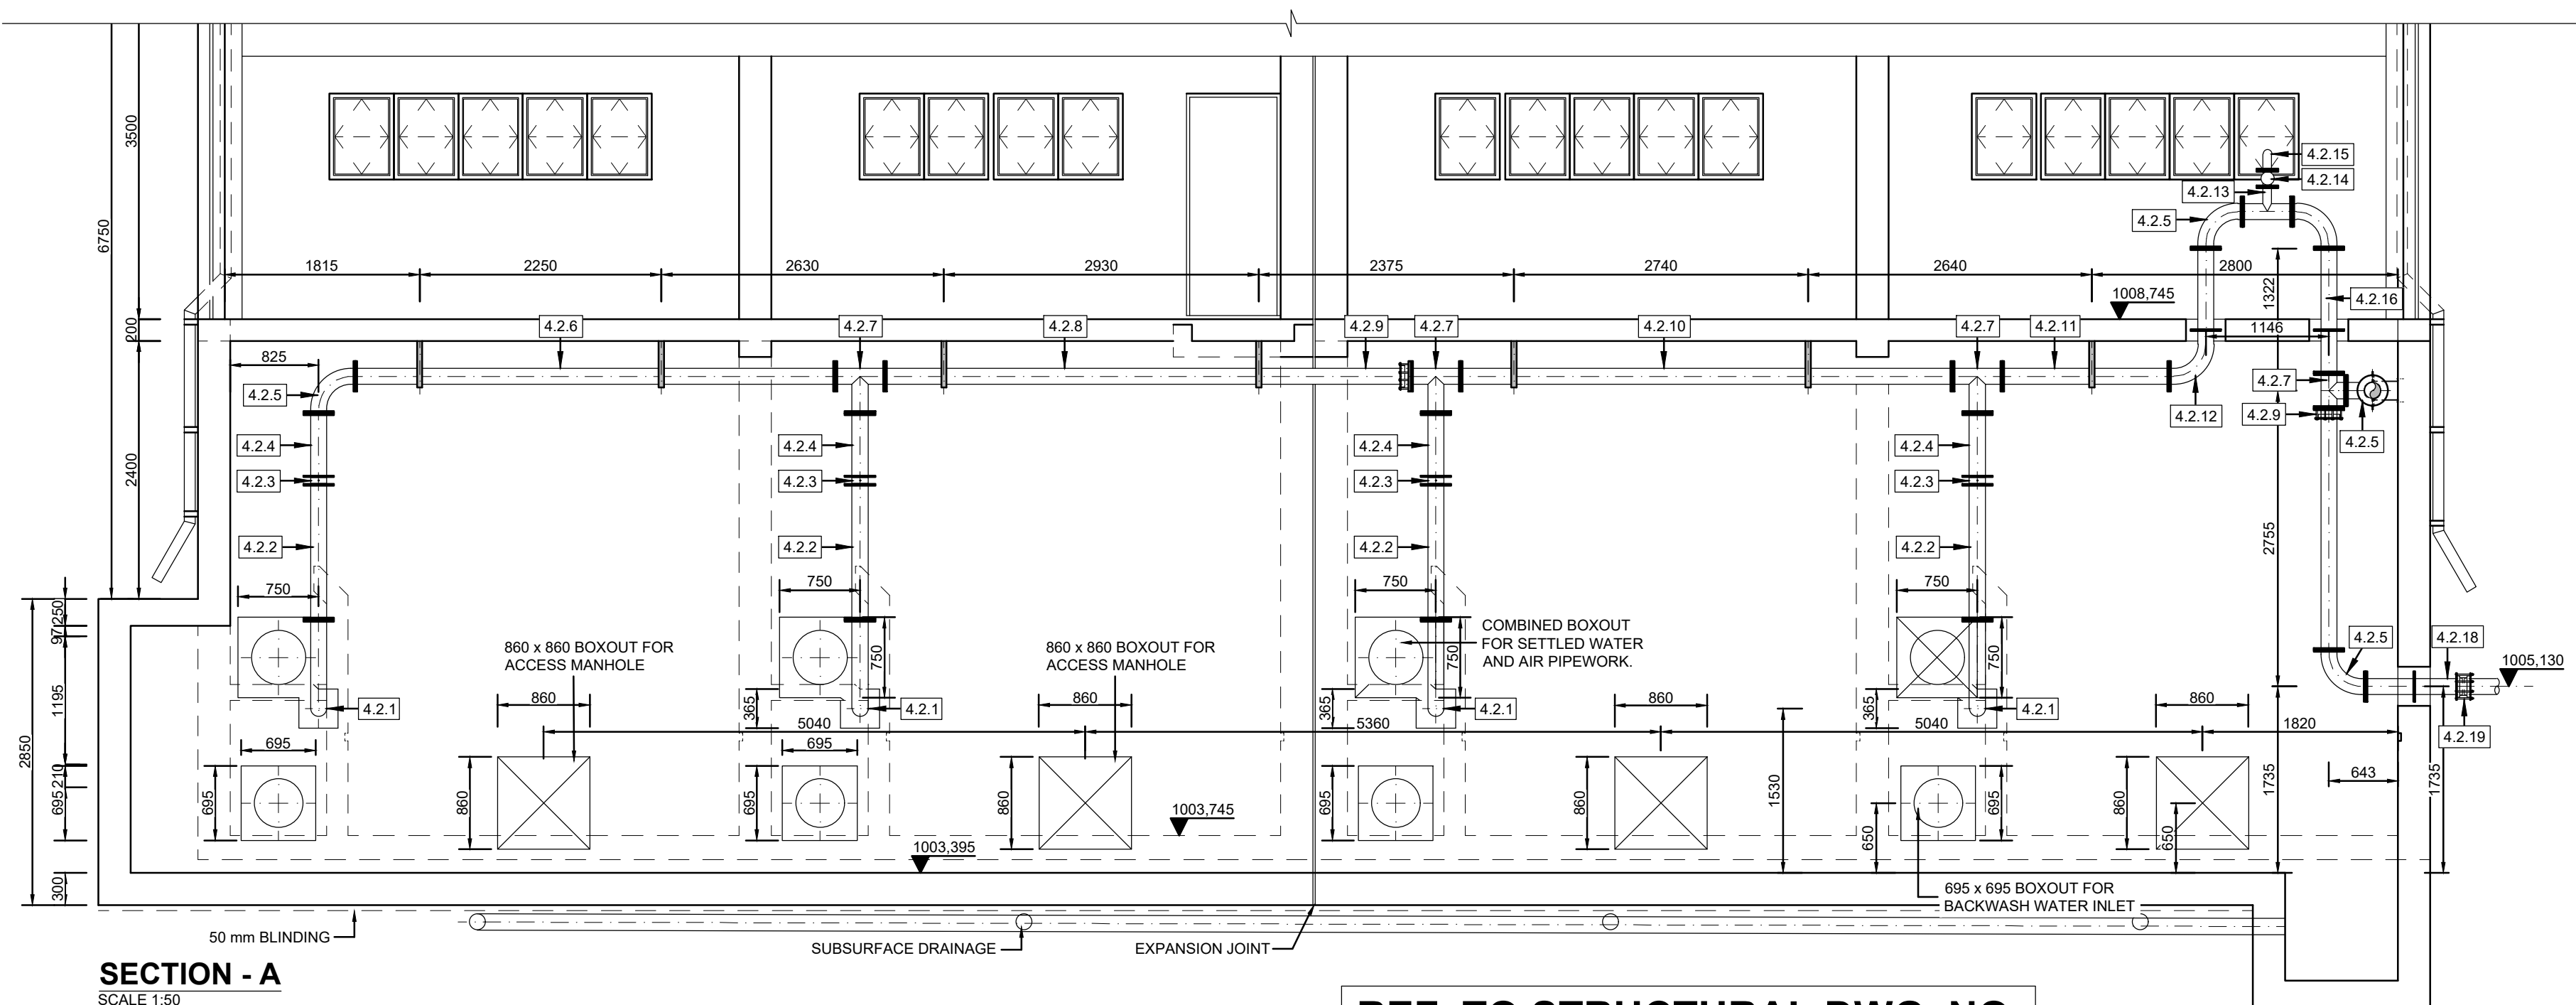


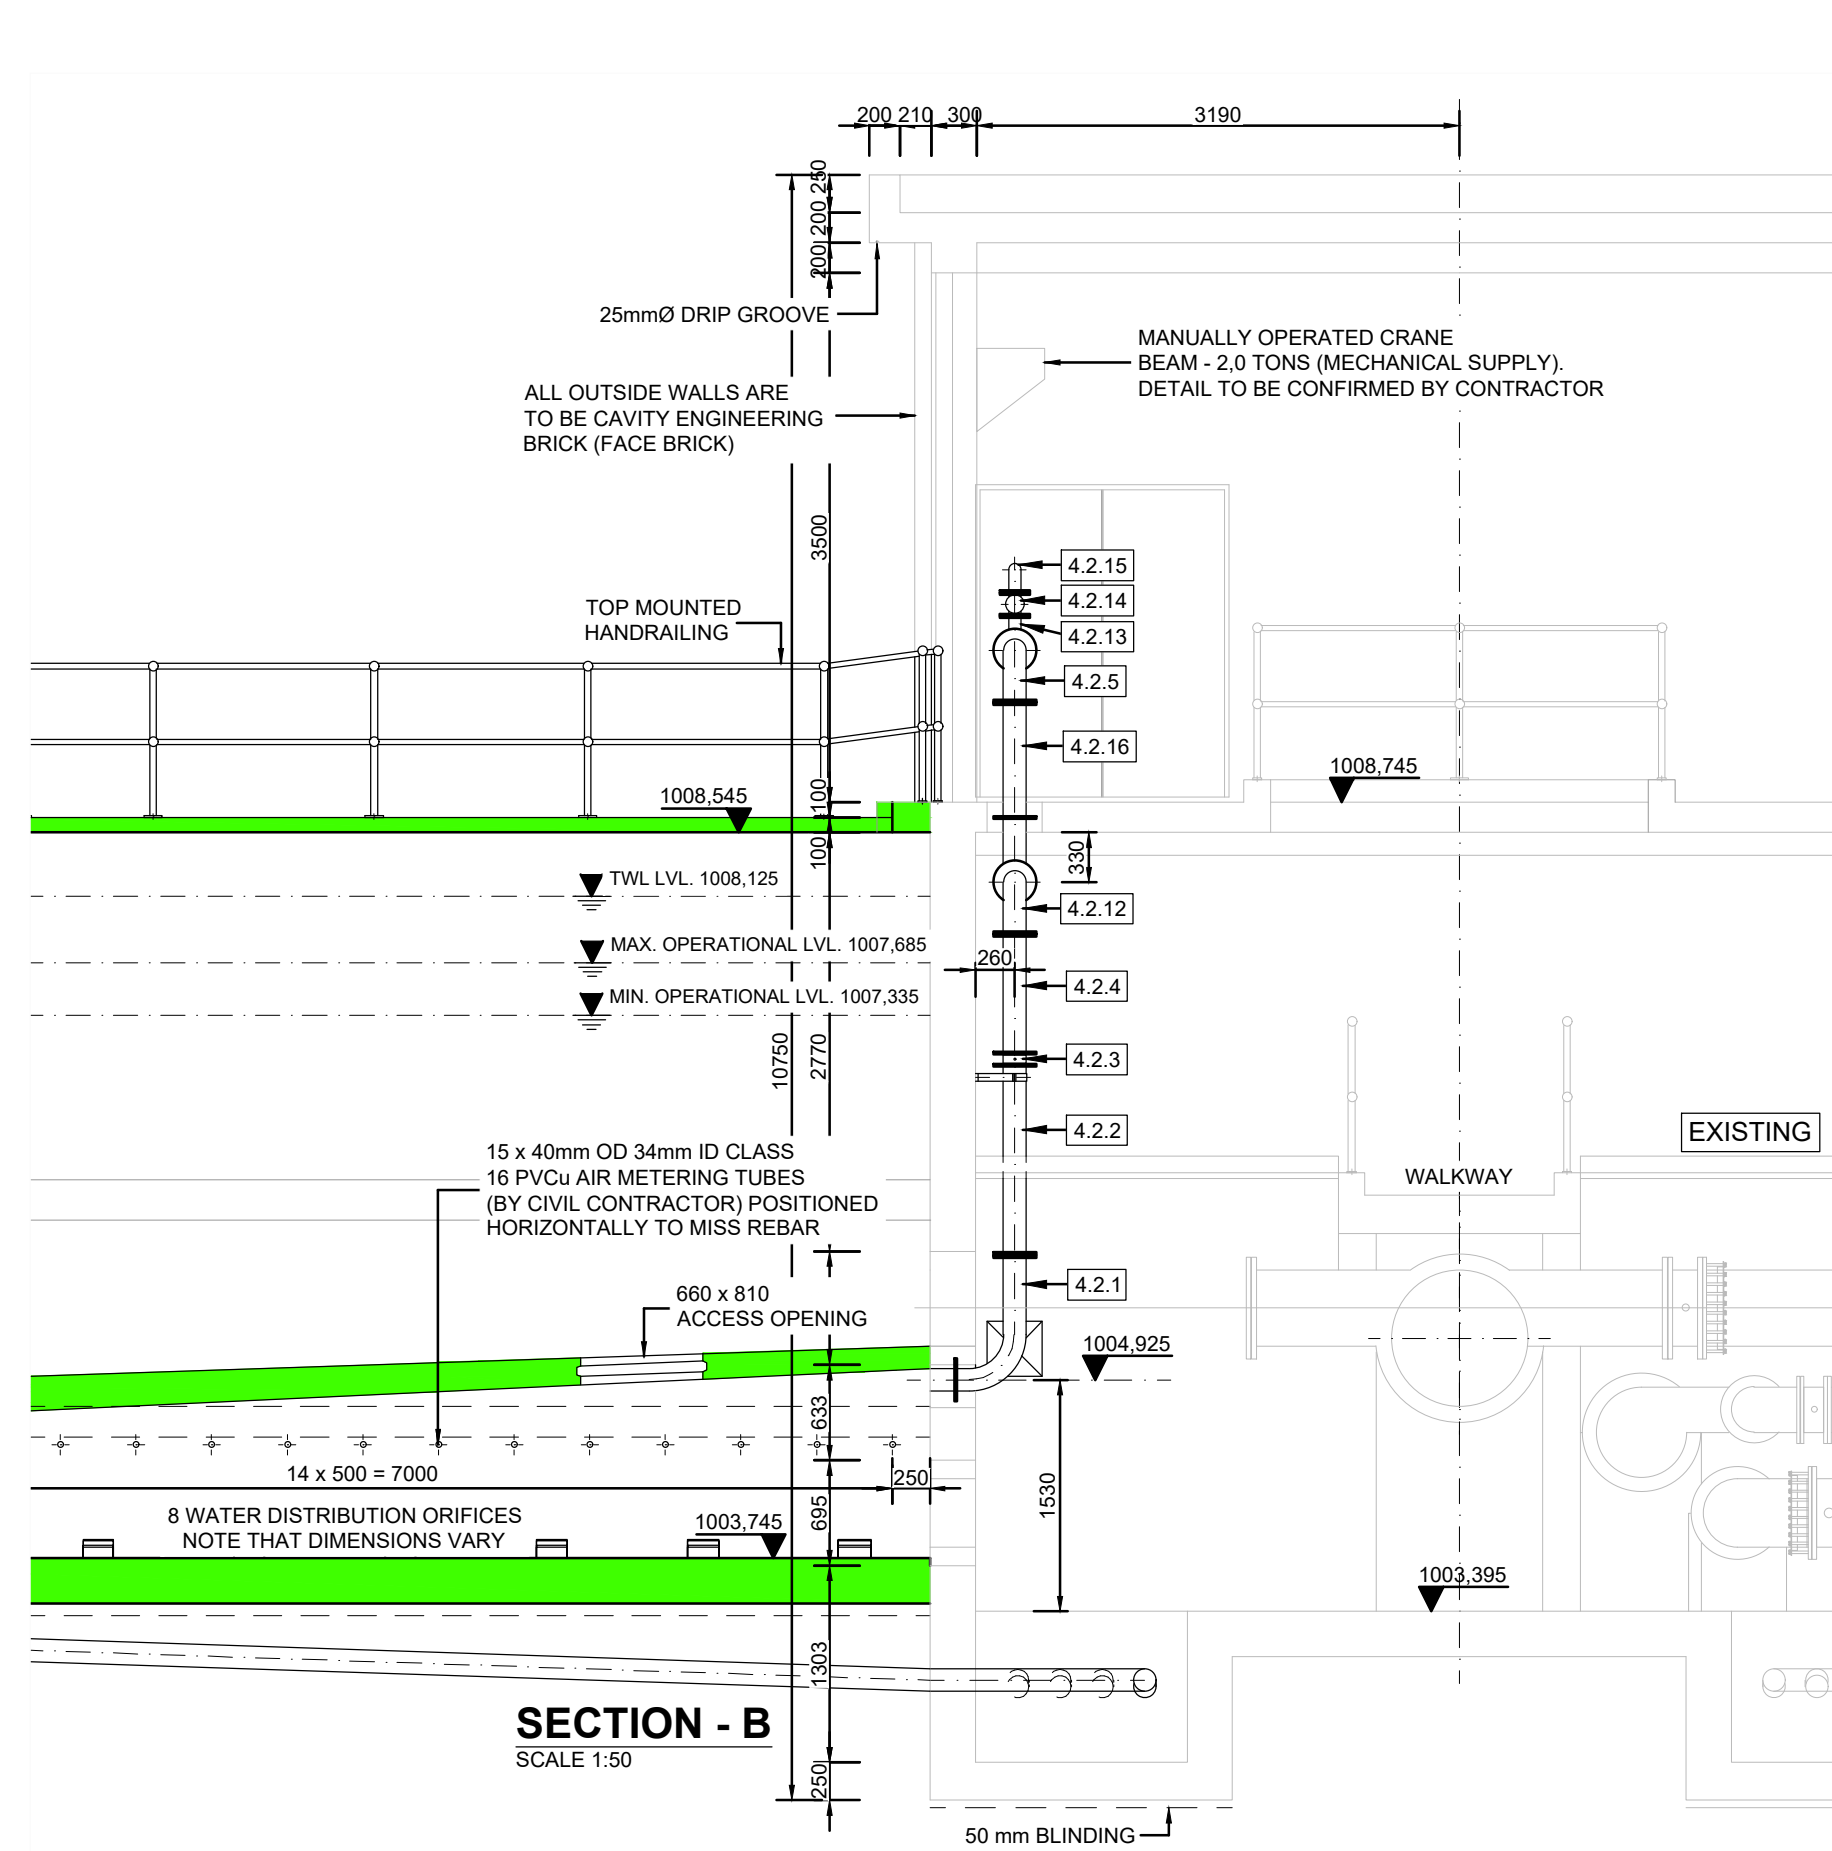

REF. TO STRUCTURAL DWG. NO. 34905-STR-310, 360 & 361

CONSTRUCTION DRAWING

ALL DIMENSIONS AND LEVELS ARE TO BE VERIFIED ON SITE BY THE CONTRACTOR BEFORE COMMENCING ANY WORK.

THE COPYRIGHT IN THIS DRAWING, INCLUDING THE DESIGN AND DETAILS SHOWN HEREON, IS RESERVED BY THE ENGINEERS.

NOTE:
ALL NEW CONCRETE STRUCTURES TO BE 35/19 MPa REINFORCED CONCRETE

NOTES:

ANY ERRORS, DIMENSIONS OR DISCREPANCIES ON THE DRAWINGS SHALL BE IMMEDIATELY REPORTED TO THE ENGINEER.

TOLERANCES SHALL BE DEGREE OF ACCURACY II UNLESS OTHERWISE SPECIFIED

ALL OVER - EXCAVATION SHALL BE MADE GOOD USING MASS CONCRETE FOR THE CONTRACTOR'S ACCOUNT.

CONCRETE

NO-FINES CONCRETE, WHERE STRUCTURAL CONCRETE IS TO BE PLACED ON TOP SHALL BE FINISHED WITH A SKIMMED COAT OF MORTAR TO LIMIT BLEEDING OF STRUCTURAL CONCRETE AND OR BLINDING OF THE NO-FINE LAYER.

ALL EXPOSED CORNERS SHALL BE CHAMFERED 25mm x 25mm.

BLINDING SHALL BE OF CLASS 15/19 mm

MASS CONCRETE SHALL BE OF CLASS 15/19 mm

STRUCTURAL CONCRETE SHALL BE OF CLASS 35/19 mm

ALL EXPOSED FORMED CONCRETE SURFACES SHALL BE SMOOTH OFF SHUTTER FINISH

ALL SURFACES EXPOSED TO WATER SHALL BE STEEL TROWELED FINISHED. WALKWAY AND TOP OF WALLS SHALL BE WOOD FLOAT FINISH.

REINFORCEMENT

CONCRETE COVER TO REINFORCEMENT TO BE MINIMUM 40mm. COVER TO REINFORCEMENT WHERE CONCRETE IS CAST AGAINST SOIL SHALL BE AT LEAST 75mm.

WELDING, HEATING TREATMENT AND GAS CUTTING OF REINFORCEMENT SHALL NOT BE PERMITTED

0 M.S 09/23 ISSUED FOR CONSTRUCTION

Rev	By	Date	Revision Details
DESIGNED	M. STEYN	NOV 2022	
CHECKED	W. DE LANGE	NOV 2022	
DRAWN	J.A. JONKER	NOV 2022	
CHECKED	W. DE LANGE	NOV 2022	

CONSULTANT

CLIENT

UMGENI
WATER · AMANZI

ALFRED NZO
MEMBER OF PARLIAMENT

water affairs
Department: Water Affairs
REPUBLIC OF SOUTH AFRICA

CLIENT APPROVED DATE

CONSULTANT SIGNATURE DATE

PROJECT TITLE

NOMLACU WTW
UPGRADES & EXTENSIONS

DRAWING TITLE

SAND FILTER
AIR PIPEWORK

SCALE: AS SHOWN

DRAWING NO. 34905-CIV-3-3

REV. 0