


PLAN
SCALE 1:50

- LEGEND**
- ① 600 x 600mm WALL-MOUNTED SLUICE GATE VALVE
 - ② 450mm Ø STEEL INLET PIPE COMPLETE WITH PUDDLE AND FLANGE. LENGTH TO SUIT CONNECTION FROM EXISTING RESERVOIR.
 - ③ 600mm Ø 100D STORMWATER PIPE
 - ④ 600 x 600 INLET VOID TO TANK

VALVE INSTALLATION
TO BE CONFIRMED

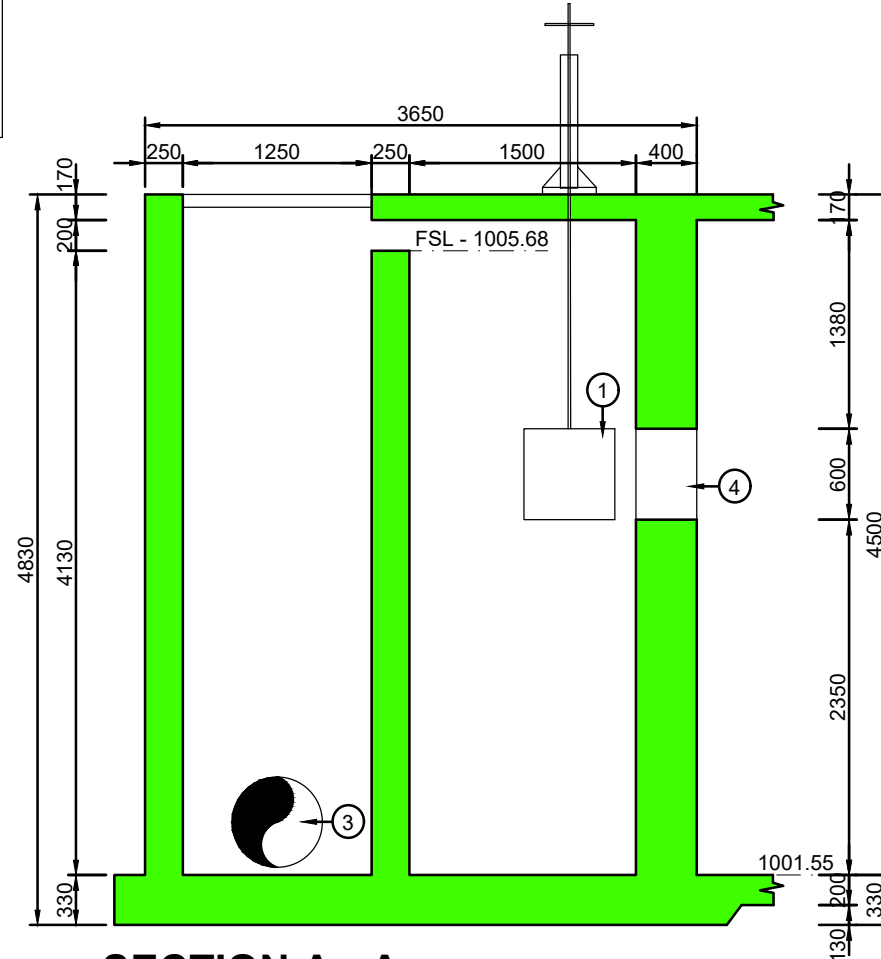

SECTION A - A
SCALE 1:50

NOTES:

ANY ERRORS, DIMENSIONS OR DISCREPANCIES ON THE DRAWINGS SHALL BE IMMEDIATELY REPORTED TO THE ENGINEER.

TOLERANCES SHALL BE DEGREE OF ACCURACY II UNLESS OTHERWISE SPECIFIED

ALL OVER - EXCAVATION SHALL BE MADE GOOD USING MASS CONCRETE FOR THE CONTRACTOR'S ACCOUNT.

CONCRETE

NO-FINES CONCRETE, WHERE STRUCTURAL CONCRETE IS TO BE PLACED ON TOP, SHALL BE FINISHED WITH A SKIMMED COAT OF MORTAR TO LIMIT BLEEDING OF STRUCTURAL CONCRETE AND OR BLINDING OF THE NO-FINE LAYER.

ALL EXPOSED CORNERS SHALL BE CHAMFERED 25mm x 25mm.

BLINDING SHALL BE OF CLASS 15/19 mm

MASS CONCRETE SHALL BE OF CLASS 15/19 mm

STRUCTURAL CONCRETE SHALL BE OF CLASS 35/19 mm

ALL EXPOSED FORMED CONCRETE SURFACES SHALL BE SMOOTH OFF SHUTTER FINISH

ALL SURFACES EXPOSED TO WATER SHALL BE STEEL TROWELED FINISHED. WALKWAY AND TOP OF WALLS SHALL BE WOOD FLOAT FINISH.

REINFORCEMENT

CONCRETE COVER TO REINFORCEMENT TO BE MINIMUM 40mm. COVER TO REINFORCEMENT WHERE CONCRETE IS CAST AGAINST SOIL SHALL BE AT LEAST 75mm.

WELDING, HEATING TREATMENT AND GAS CUTTING OF REINFORCEMENT SHALL NOT BE PERMITTED

ALL DIMENSIONS AND LEVELS ARE TO BE VERIFIED ON SITE BY THE CONTRACTOR BEFORE COMMENCING ANY WORK.

THE COPYRIGHT IN THIS DRAWING, INCLUDING THE DESIGN AND DETAILS SHOWN HEREON, IS RESERVED BY THE ENGINEERS.

LEGEND:

NOTE:
ALL NEW CONCRETE STRUCTURES TO BE 35/19 MPa REINFORCED CONCRETE

| | | | |
|-----|-------|-------|-------------------------|
| 0 | W.D.L | 09/23 | ISSUED FOR CONSTRUCTION |
| Rev | By | Date | Revision Details |

CONSULTANT

| | | |
|----------|--------------|----------|
| DESIGNED | S. MKHATSHWA | NOV 2022 |
| CHECKED | W.DE.LANGE | NOV 2022 |
| DRAWN | S. MKHATSHWA | NOV 2022 |
| CHECKED | W.DE.LANGE | NOV 2022 |

CLIENT



| | |
|-----------------|------|
| CLIENT APPROVED | DATE |
|-----------------|------|

| | |
|--|--|
|  bvi ENGINEERING PROCUREMENT MANAGEMENT TEL: (043) 743 7660/722 2738 FAX: (043) 743 7698 E-MAIL: els@bvi.co.za | P.O.BOX 11015 SOUTHERNWOOD EAST LONDON 5213 56 BONZA BAY ROAD BEACON BAY NORTH EAST LONDON 5205 |
|--|--|

| | |
|----------------------|------|
| CONSULTANT SIGNATURE | DATE |
|----------------------|------|

| |
|--------------------------------------|
| PROJECT TITLE |
| NOMLACU WTW UPGRADES & EXTENSIONS |

| |
|----------------------------------|
| DRAWING TITLE |
| 1000KL RESERVOIR INLET DETAIL |

| | |
|---------------------------|-----------|
| SCALE 1:10 | |
| DRAWING NO. 34905-CIV-4-4 | REV. 0 |

ORIGINAL SIZE A3

CONSTRUCTION DRAWING

REF. TO STRUCTURAL DWG. NO.
34905-STR-5-1 TO 5-4
34905-STR-320 & 370