



## Headline Statistics

WCWSS DAM STORAGE (%)

**63.2**

WEEKLY DAM LEVEL CHANGE (%)

**-2.10**

AVERAGE TOTAL DAILY WATER USE (MLD)

**1046**

## Water Resource Status

WATER RESOURCE STATUS	MEANING OF CURRENT STATUS
Early Drought Caution	<p>'Continued water wise use encouraged due to lower than anticipated dams level, cautioning possible start of a drought cycle'</p> <p>The main dams supplying the City are approximately 15% lower than last year - as shown on Page 3. While there is no immediate reason for concern and no expected restrictions for the next year, this updated drought risk status is part of the City's proactive approach to monitoring for and managing future droughts. This status and the corresponding actions are discussed in the Water Outlook 2023. The latest analysis has been incorporated into the dashboard update</p> <p>The Water Resource Status will be updated again in February 2026.</p>

## Water Production from Different Sources

MAJOR DAMS (MLD)

**1035**


MINOR DAMS (MLD)

**4**

GROUND WATER AND SPRINGS (MLD)

**7**

## Overall Water Usage Trend (2010 - Present)

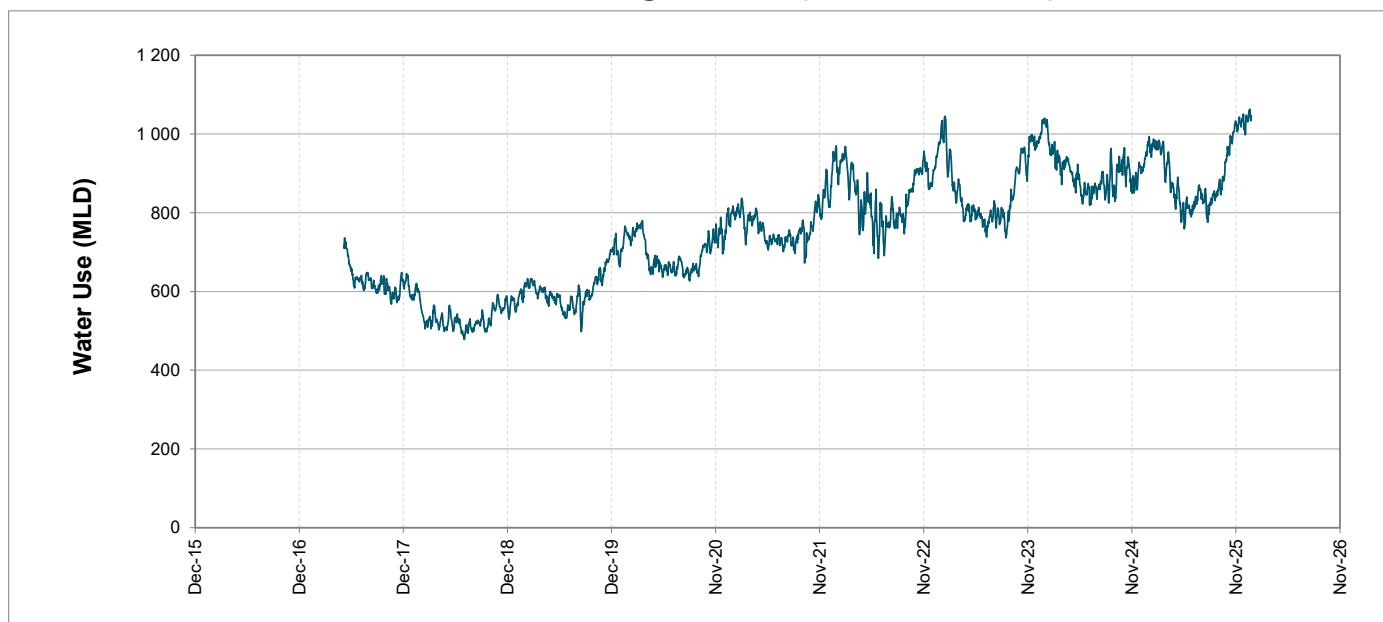

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


## Water Stored in Major Dams (WCWSS)

Overall Percentage Full **63.2%**


Weekly Change **-2.1%**

MAJOR DAMS (WCWSS)	STORAGE								
	CAPACITY	% <span style="color: #0070C0;">23 January 2026</span>		%		%		%	
		MI	23 January 2026	Previous week	2025	2024	2023	2022	
BERG RIVER	130 010		64.8		67.2	84.5	86.2	80.6	90.5
STEENBRAS LOWER	33 517		60.8		62.2	75.1	78.3	64.3	84.1
STEENBRAS UPPER	31 767		81.1		81.4	96.1	95.2	94.0	92.5
THEEWATERSKLOOF	480 188		58.0		60.2	82.6	80.4	60.2	90.8
VOËLVLEI	164 095		71.5		74.1	83.3	79.0	49.9	84.7
WEMMERSHOEK	58 644		70.6		71.5	77.5	93.7	77.3	80.0
<b>TOTAL STORED</b>	<b>898 221</b>		<b>567 978</b>		<b>586 462</b>	<b>744 631</b>	<b>739 137</b>	<b>572 586</b>	<b>797 295</b>
<b>% STORAGE</b>			<b>63.2%</b>		<b>65.3%</b>	<b>82.9%</b>	<b>82.3%</b>	<b>63.7%</b>	<b>88.8%</b>



### WCWSS Storage Record (2008 - Present)

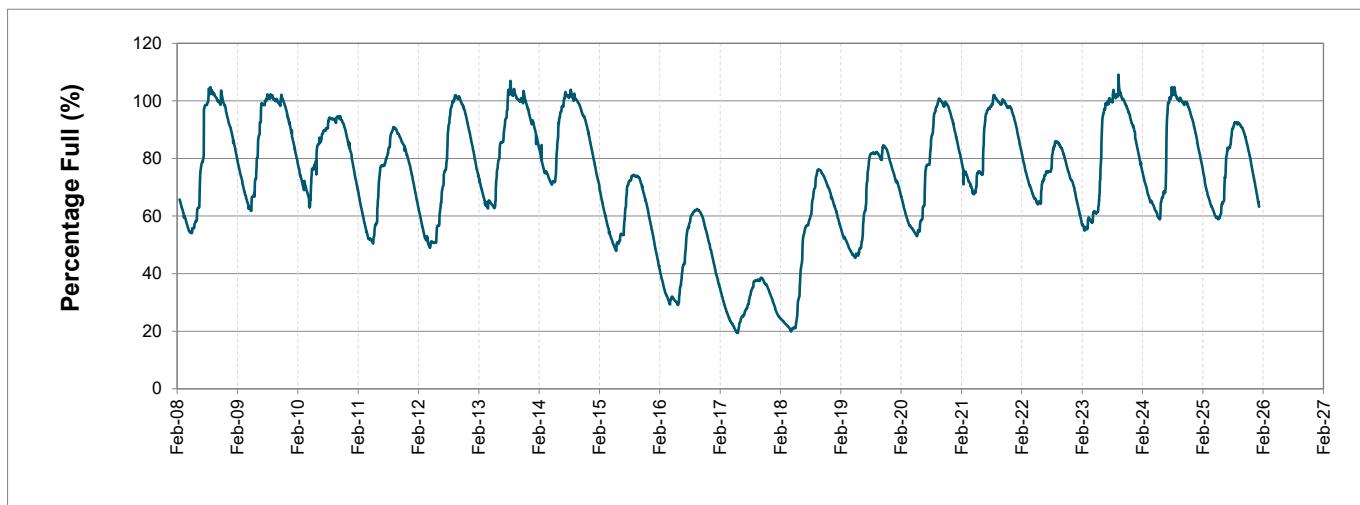

### WCWSS Comparative Storage Graph

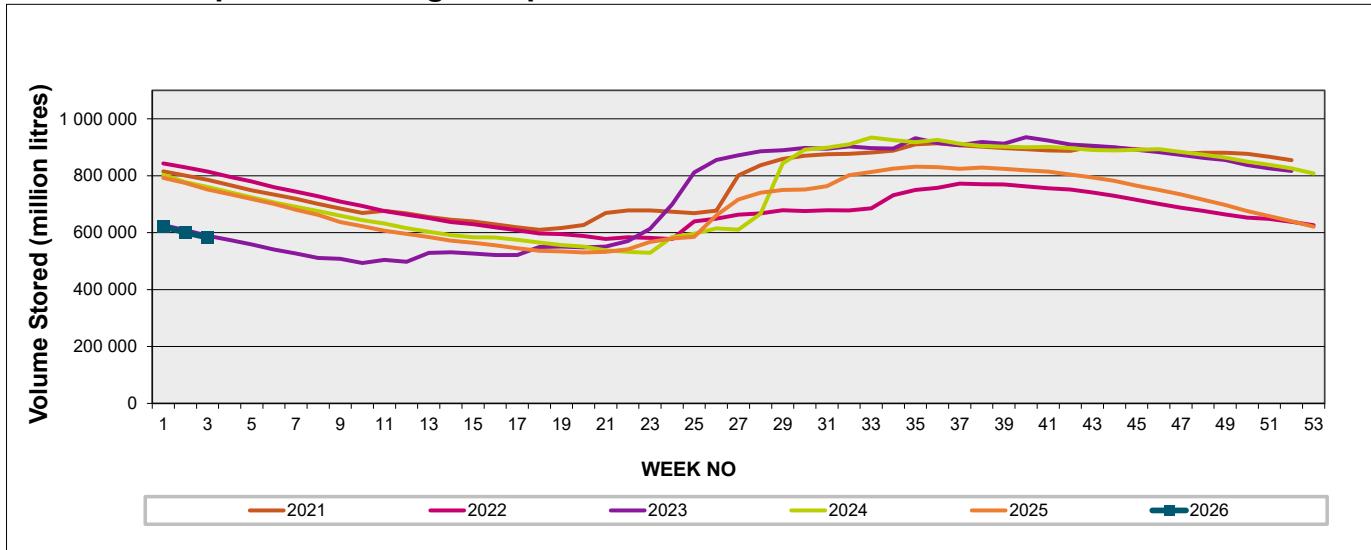

## Projected WCWSS Dam Storage Levels

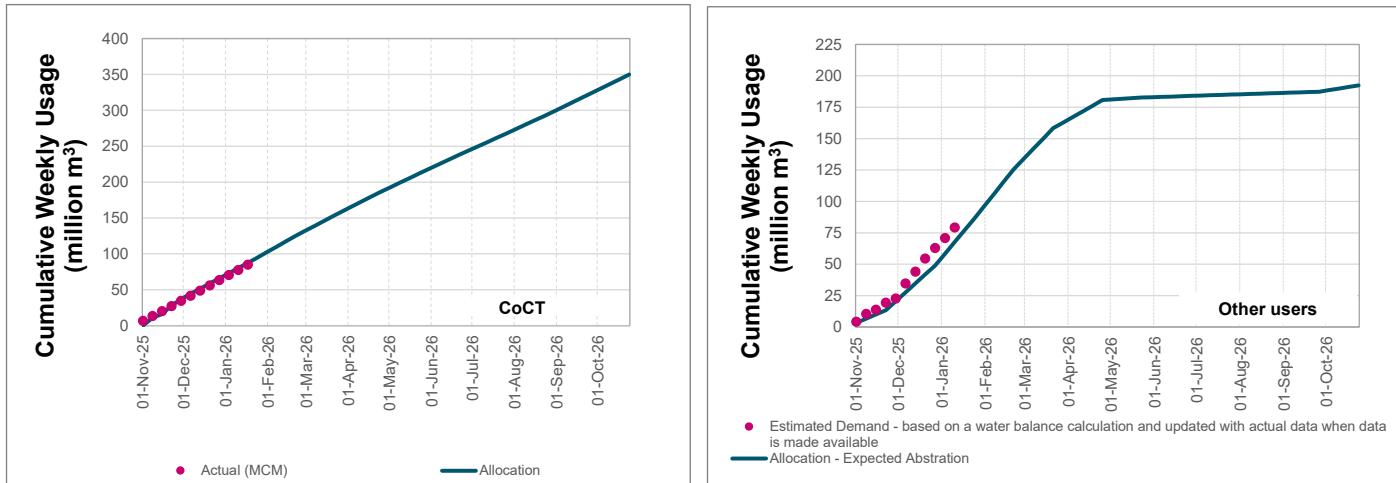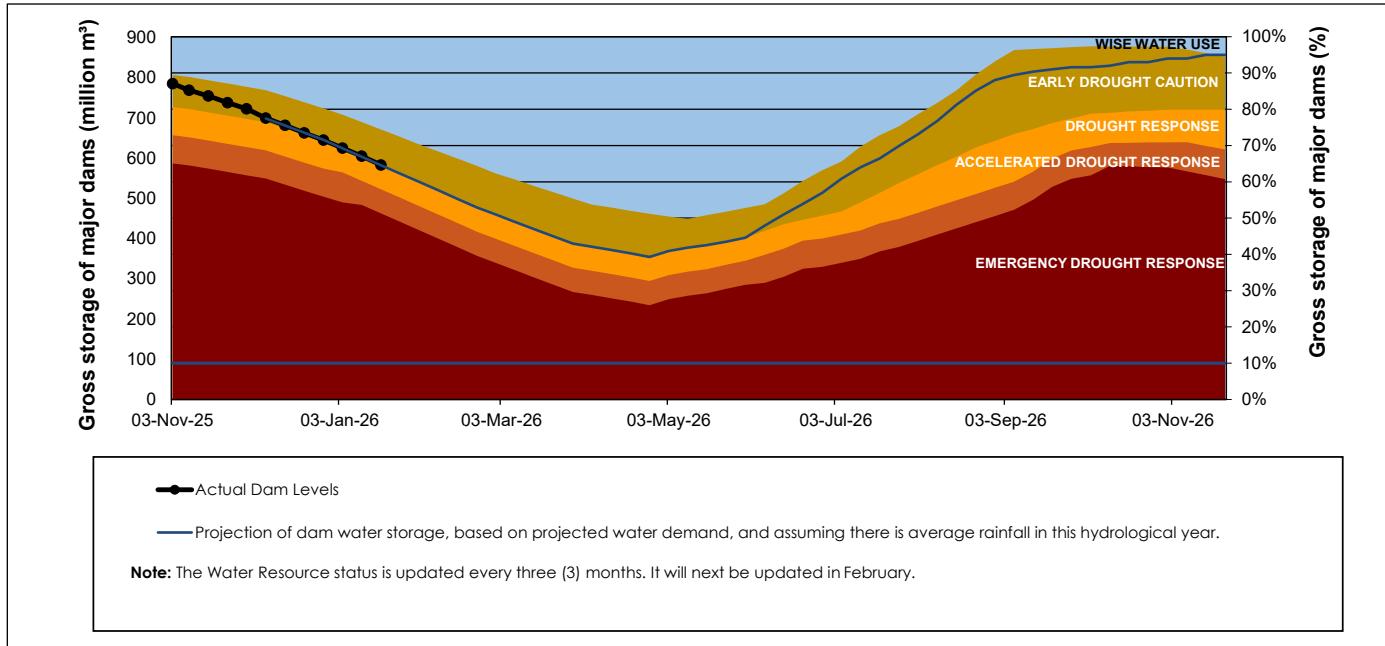

## Water Stored in Minor Dams

Overall Percentage Full	50.7	Weekly Change			-0.42			
MINOR DAMS	Storage							
	Capacity	%	%	%	%	%	%	%
	MI	23 January 2026	Previous week	2025	2024	2023	2022	
ALEXANDRA (Table Mountain)	126	35.2	34.4	43.7	46.1	48.5	76.7	
DE VILLIERS (Table Mountain)	243	57.9	57.6	91.0	98.1	81.2	61.7	
HELY-HUTCHINSON (Table Mount)	925	14.3	13.9	60.3	38.3	5.0	42.8	
KLEINPLAATS (Simon's Town)	1 368	42.0	46.1	29.2	66.8	38.2	75.0	
LAND-EN-ZEEZICHT (Helderberg)	451	83.0	83.5	90.8	75.3	86.9	92.2	
LEWIS GAY (Simon's Town)	182	54.8	47.0	81.4	58.4	60.5	83.0	
VICTORIA (Table Mountain)	128	47.3	45.6	92.3	79.6	80.3	58.8	
WOODHEAD (Table Mountain)	954	84.8	82.9	44.6	64.1	81.2	62.5	
Total Stored	4 377	2221.3	2239.6	2327.1	2691.7	2196.6	2871.1	
Percentages stored		50.7	51.2	53.2	61.5	50.2	65.6	


## Rainfall Recorded

RAINFALL (mm)	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	Jan	
	Total*	LT Average							
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	15.3
Brooklands	2.0	0.0	0.0	0.0	0.0	0.0	0.0	4.0	27.7
Newlands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.5	37.4
Steenbras	0.0	2.0	0.0	0.0	0.0	0.0	0.0	0.0	29.5
Table Mountain (Woodhead)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	46.0	52.7
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	0.0	16.1	24.9
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.1	13.0
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.2	13.2
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	20.6
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	21.2

Notes: \*Total/cummulative rainfall for month indicated above  
LT: Long Term

## Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

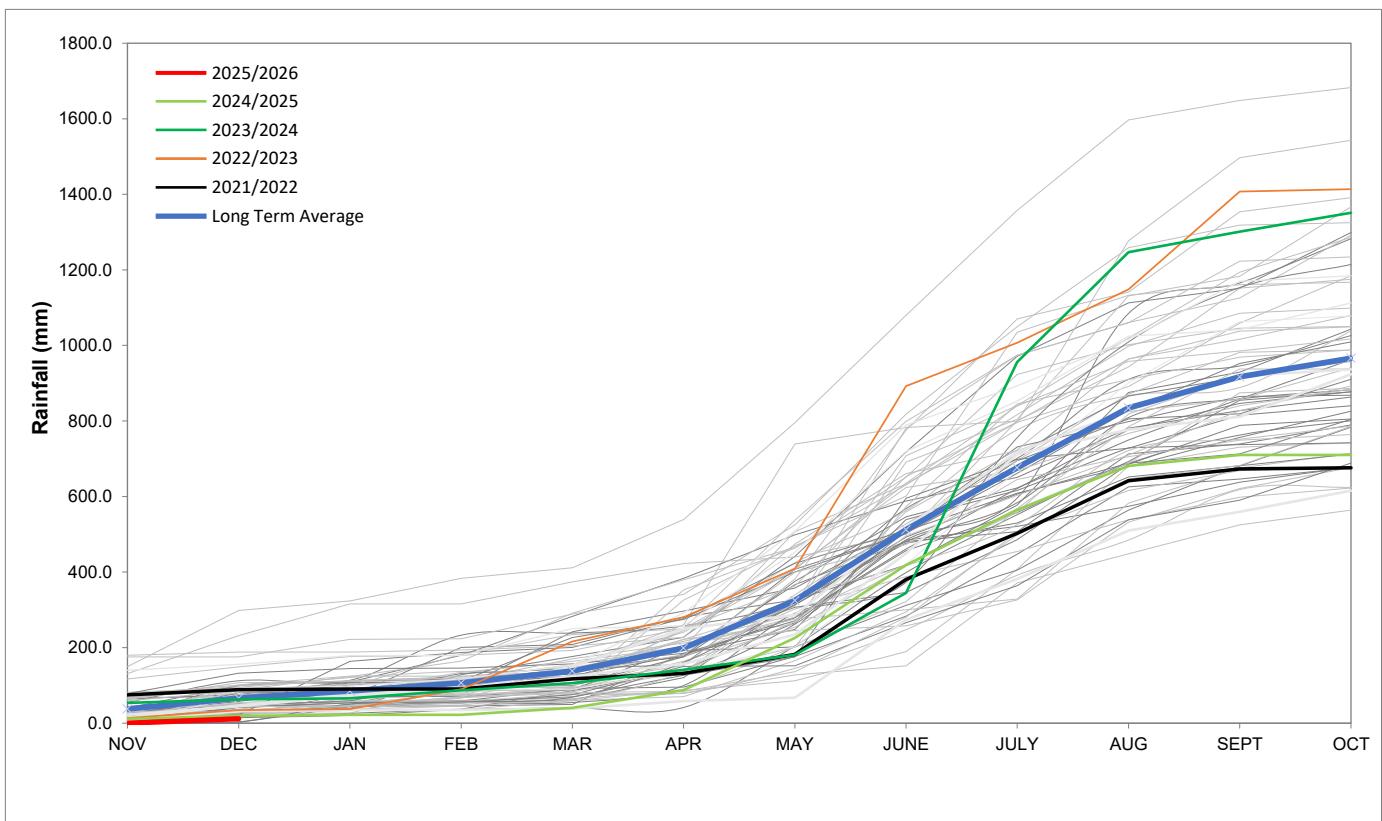

## Drinking Water Quality

### SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jan-22	99.04	98.00
Feb-22	99.04	98.00
Mar-22	98.99	98.00
Apr-22	98.96	98.00
May-22	98.90	98.00
Jun-22	98.96	98.00
Jul-22	99.46	98.50
Aug-22	99.47	98.50
Sept-22	99.46	99.00
Oct-22	99.47	99.00
Nov-22	99.45	99.00
Dec-22	99.36	99.00
Jan-23	99.36	99.00
Feb-23	99.35	99.00
Mar-23	99.29	99.00
Apr-23	99.24	99.00
May-23	99.24	99.00
Jun-23	99.18	99.00
Jul-23	99.19	99.00
Aug-23	99.14	99.00
Sept-23	99.10	99.00
Oct-23	99.10	99.00
Nov-23	99.04	99.00
Dec-23	99.15	99.00
Jan-24	99.16	99.00
Feb-24	99.12	99.00
Mar-24	99.16	99.00
Apr-24	99.20	99.00
May-24	99.21	99.00
Jun-24	99.26	99.00
Jul-24	99.27	99.00
Aug-24	99.31	99.00
Sept-24	99.33	99.00
Oct-24	99.37	99.00
Nov-24	99.42	99.00
Dec-24	99.42	99.00
Jan-25	99.48	99.00
Feb-25	99.57	99.00
Mar-25	99.61	99.00
Apr-25	99.65	99.00
May-25	99.66	99.00
Jun-25	99.62	99.00
Jul-25	99.69	99.00
Aug-25	99.69	99.00
Sept-25	99.70	99.00
Oct-25	99.70	99.00
Nov-25	99.72	99.00
Dec-25	99.72	99.00

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 99%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.